


**Manufacturer:** Quick Bauprodukte GmbH  
**Test requirements:** Test instruction fibre concrete "Norwegian Standard"  
**Material / Mixture-No.:** Quick fiber concrete M1  
**Concrete quality:** C45/55  
**Exposure class concrete:** acc. to Eurocode 2 (EC2) X0 / XC4 / XD 3 / XF4 / XA2

**Article / Article-No.:** Mounting-Bipo 50 with 1 trough, without wire / 22036  
**Concrete cover:** 50 mm  
**Production date:** 08.12.2022  
**Test period:** 23.01.-26.01.2023

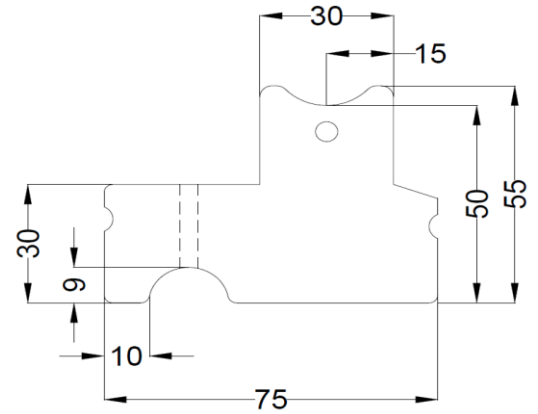

#### Results dimension test

Part No.	H	Vippediagonal
1	50,0	61,0
2	50,0	61,0
3	51,0	62,0
<b>mean</b>	<b>50,3</b>	<b>61,3</b>

#### Results water absorption test

Part No.	Storage weight in g after 48 hours heat treatment curing at +105°C	Weight in g after 30 min. immersion	Water content in % after 30 min. (to be < 5 %)	Weight in g after 24 hours immersion	Water content in % after 24 hours (to be < 8,5 %)
1	200	208	4,0%	214	7,0%
2	202	208	3,0%	216	6,9%
3	203	210	3,4%	218	7,4%
<b>mean</b>			<b>3,5%</b>		<b>7,1%</b>

#### Results breaking load test

Part No.	breaking load F / kN (to be >6 kN)
1	8,4
2	8,5
3	8,8
<b>mean</b>	<b>8,6</b>

This certificate complies to the requirements of DIN / EN 10204:2005-01-3.1

The buyer is not released from any entry control.  
It is also irrelevant in case of incorrect use or handling.